


SW. #4	OPEN AUXILIARY SWITCH
SW. #3	CLOSE AUXILIARY SWITCH
SW. #2	OPEN LIMIT SWITCH
SW. #1	CLOSE LIMIT SWITCH

SWITCH LAYOUT

OPTIONAL HEATER & THERMOSTAT

NOTES:
 POWER TO TERMINALS ONE & TWO OPENS THE VALVE (CCW ROTATION)
 POWER TO TERMINALS ONE & THREE CLOSES THE VALVE (CW ROTATION)
 TERMINALS 4 & 5 FOR LIGHT INDICATION
 TERMINALS 6 THROUGH 11 FOR AUXILIARY SWITCHES & TERMINAL 12 FOR HEATER & THERMOSTAT.

WIRING DIAGRAM SHOWS THE ACTUATOR IN THE OPEN POSITION

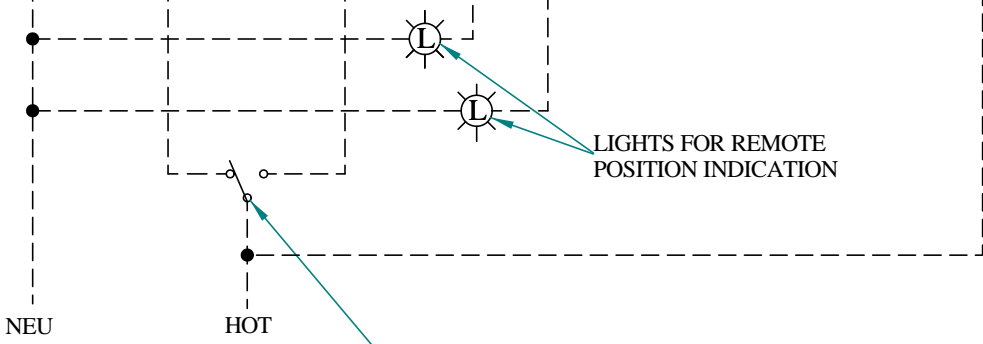

LIGHTS FOR REMOTE POSITION INDICATION

SPDT SWITCH SHOWN FOR ILLUSTRATION ONLY

FIELD WIRING

115/230Vac/1Ph/60Hz
 SUPPLY POWER

NO.	REVISION	DATE	BY
I _C I Indelac Controls, Inc.		Florence, Ky. 41042	
WIRING DIAGRAM, 115/230VAC "K" ACTUATOR WITH MECHANICAL TORQUE SWITCHES, OPTIONAL 2 AUX. SWITCHES, HEATER & THERMOSTAT & BRAKE			
JLR	11-25-2009	W091125	